


Led Panel Emergency Kit

Data Sheet

For Series: OT-EPD-3 series

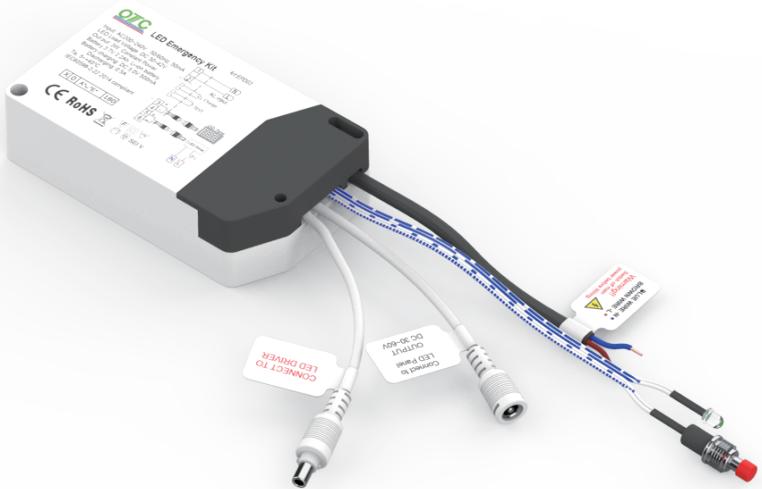

OTC IND CO., LTD

TEL: 0086-575-82913009 | Website: www.otcenterprise.com | Email: info@otcind.net



Dear partners,

* Thanks for Choosing OTC LED emergency products for your projects.

OTC always pursue high quality, steady quality products, competitive price and one-stop customer service, and offer enjoyable installation experience.

* All the OTC emergency lamp with 5 years quality guarantee (Battery 3 years) . If any doubts/ questions, please contact OTC project support team directly by email support@otcind.net . You will get solutions in 7~24 hours rapidly.

Contents

1 Security related information	2
2 Packing list	2
3 Basic Parameters	3
4 General construction	4
5 Maintained & non-maintained changeover	5
6 Emergency function	6
7 Self & remote test system	7
8 Emergency controll logic	8
9 Installation guide	9
10 EM inspection record table	10

1 Security related information

- Installation should be carried out in accordance with the latest edition of the I.E.E. Wiring regulations and taking into consideration the latest building regulations.
- Ensure that all electrical connections are tight with no loose strands, including factory made connections.
- Ensure there is adequate free air circulation of at least 100mm around the luminaire. It is the installer's responsibility to consider fire risk and take appropriate precautions.
- A separate enclosure may be required if this unit is to be used in dusty and wet environments.

Q.C. date label, installation in an improper working environment or installation not according to the current edition of the I.E.E. Wiring Regulations . The guarantee is also invalidated if the luminaire has been I.R. tested. Should this product fail during the guarantee period it will be replaced free of charge, subject to correct installation and return of the faulty unit. We do not accept responsibility for any installation costs associated with the replacement of this product. Your statutory rights are not affected. We reserve the right to alter specifications without prior notice.

2 Packing list




User manual *1

Installation pack *1

3 Basic Parameters

Model	OT-EPD- 3N
Material	PC
Dimension of driver	124*79*30mm
Degree of protection	IP20
Input Voltage	AC200-240V 50/60HZ
Input power	3W
Power factor	>0.5
Extension cable	DC5521 with clip, 1 set
↓ Next are Emergency parameters ↓	
EM mode	Non -maintained
Standard	60598-2-22:2014
Out put	DC30-60V, 3W Constantly Power
Emergency change over	<0.5S
Emergency Pack	3.7V 2.4Ah Li-ion Pack
Emergency time	3 hours
Test	Manual test
Charging indicator	Green
Faulty indicator	No
EM power	3W Constantly Power
Luminous Flux(EM)	350Lm

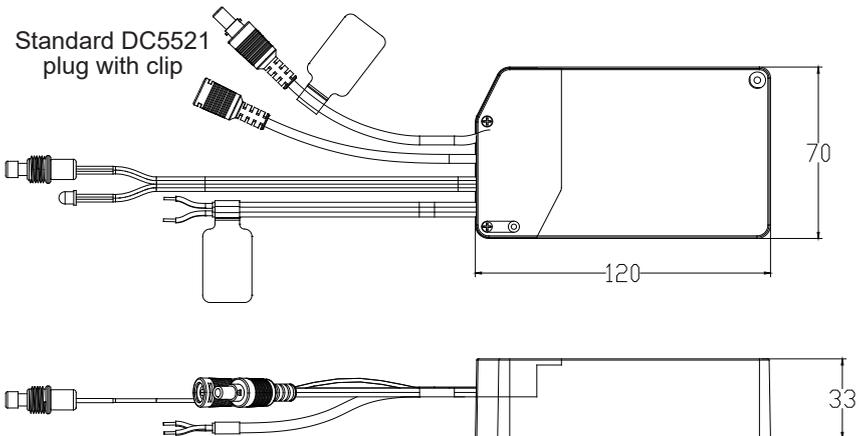

4 Emergency Wiring

ADDITIONAL INFORMATION - COMPONENT REPLACEMENT

- The emergency module contains no user replaceable components other than the battery pack.
- The battery has a 4 year service life provided it is operated and maintained by regular testing, as detailed in this Usermanual. Failure to maintain or change the battery may result in reduced duration in emergency mode.

